


WATER & SEWER INSTALLATIONS

Compliance Issues:

1. - All Installations of Water & Sewer on Private Property (*beyond the PUBLIC WAY*) must be in compliance with current Mn. State Plumbing Code.
2. - Materials for Sewer Piping SHALL be in compliance with **Ch. 7** and the Installation Standards of **IAPMO**.
3. - Sewer Piping installed on Private Property SHALL be Air Tested at 5 lbs. psi. or other methods listed in **Sec. 712 Testing**.
4. - Materials for Water Supply and Distribution SHALL be in compliance with **Ch. 6** and the Installation Standards of **IAPMO**. **200 psi minimum**.
5. - NON-Metallic Water Supply materials SHALL include a Tracer Wire in compliance with **Sec. 604.9**
6. - Tracer Wires are to terminate, near the public way; **with Grounding Rods and Access Terminals** as shown in the detail below and in cooperation with the City of Faribault Utilities Superintendent. 507-384-0559.

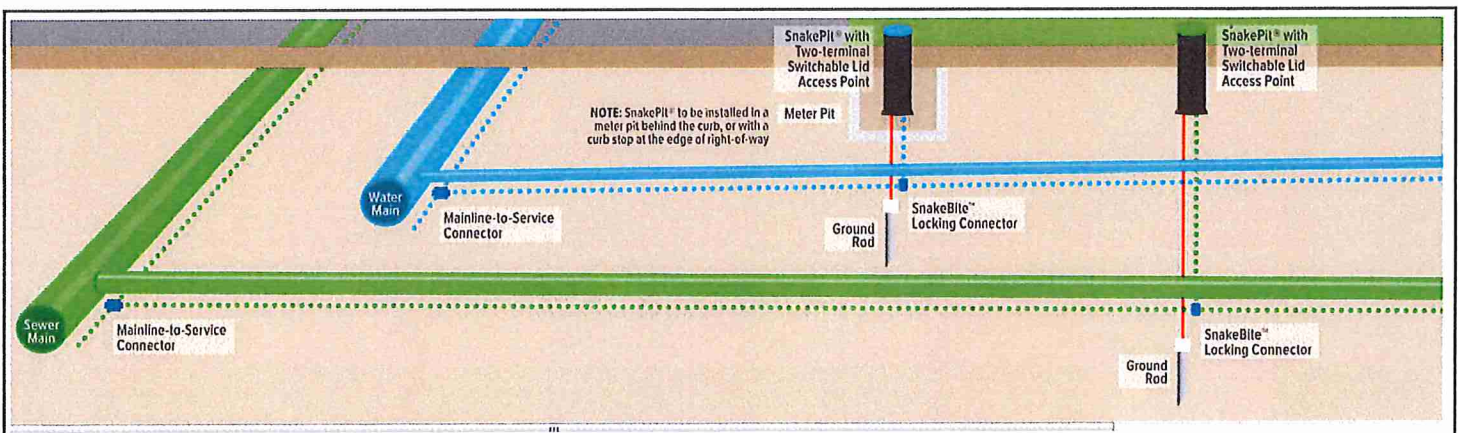

7. - **Mn. State Law 326B.46 subdv. 1(a)** requires all individuals installing Water & Sewer Services to have a current Mn. License as a Master, Journeyman or Pipe Layer. **NO other individuals may be involved!**